



TOWNSHIP OF NORWICH


BUILDING DEPARTMENT

DATE ISSUED:
MARCH 2013

HOUSE ADDITION WITH FULL BASEMENT

SCALE:
NTS

PAGE NO.:
E 1

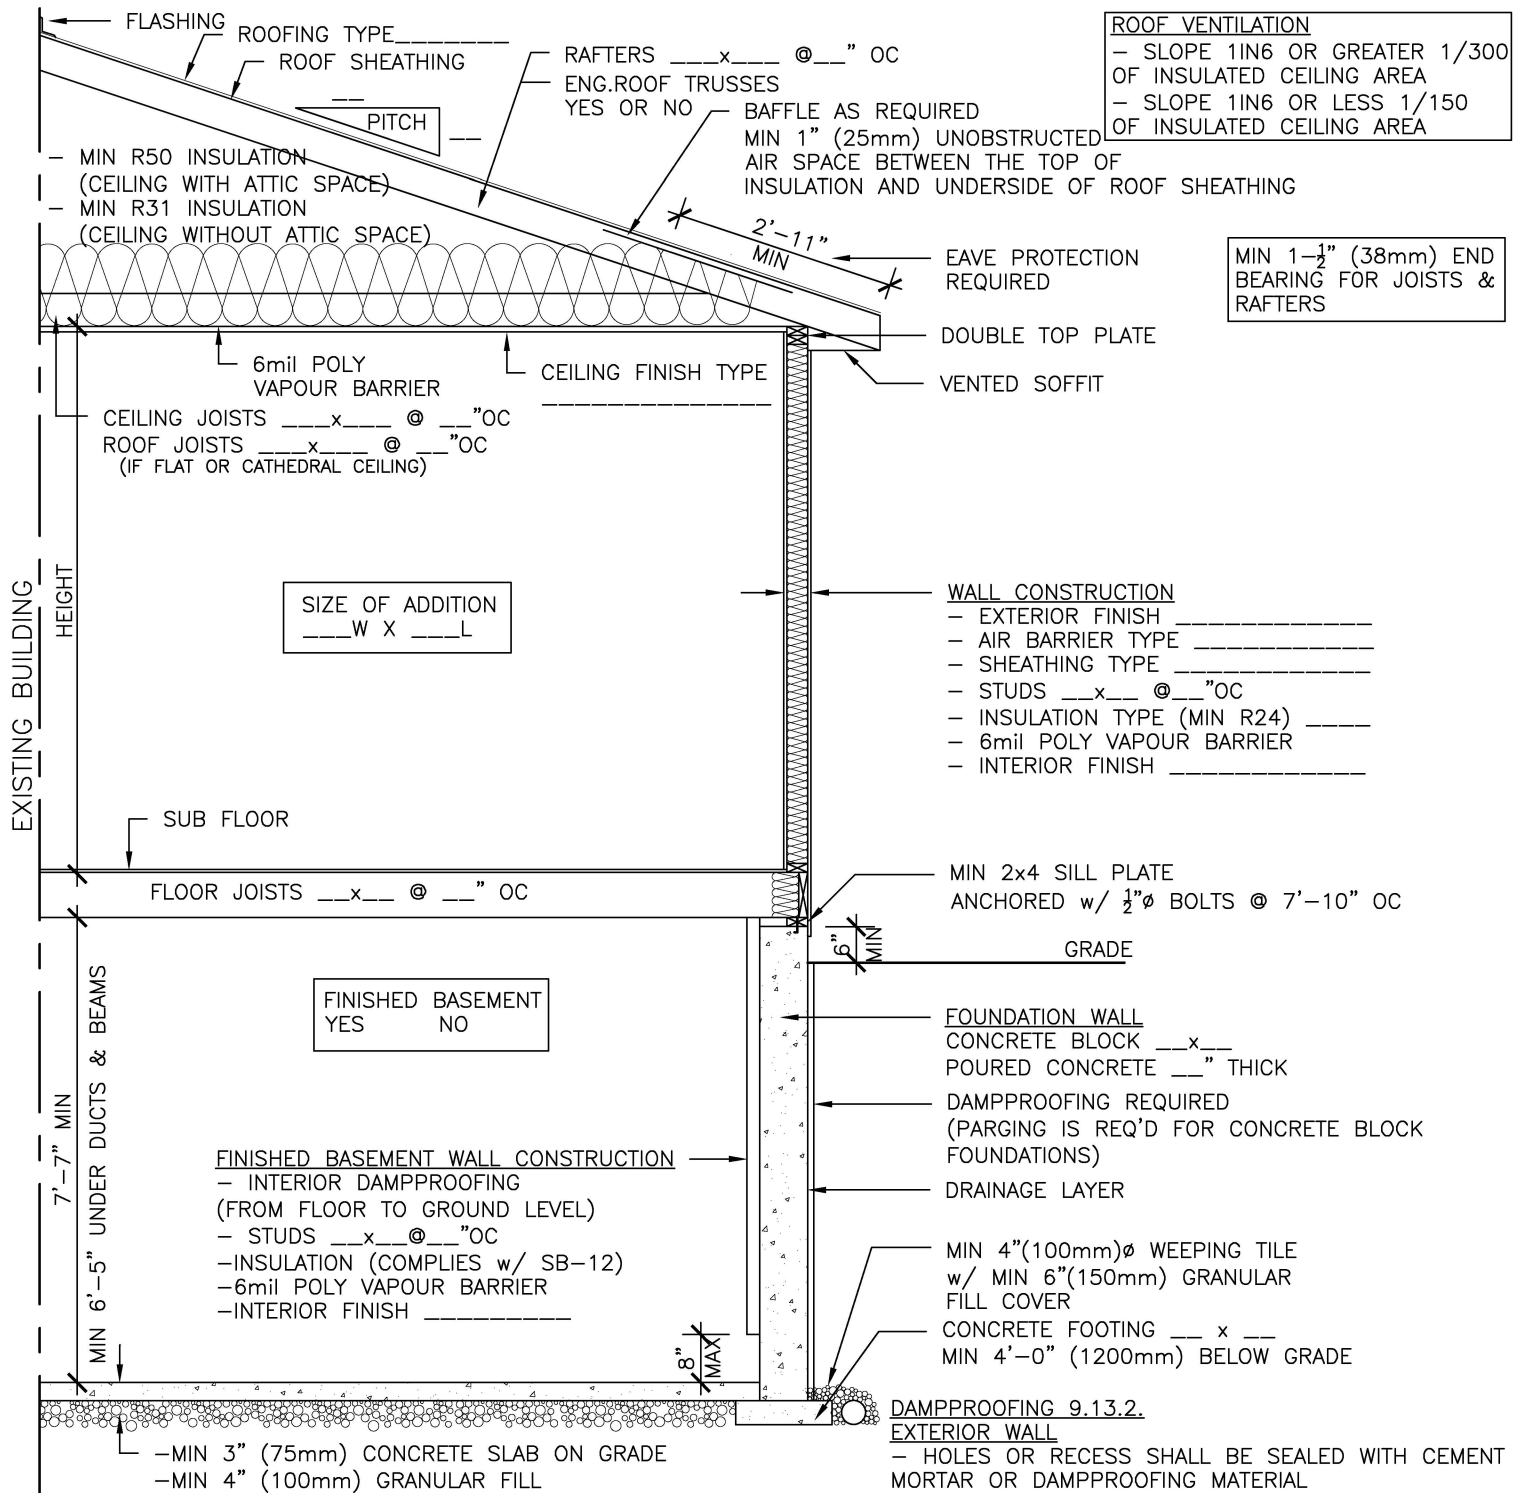

MIN 15MPa CONCRETE TO BE USED FOR SLAB ON GRADE WHERE NO DAMPPROOFING IS PROVIDED
MIN 25MPa CONCRETE TO BE USED FOR SLAB ON GRADE WHERE DAMPPROOFING IS PROVIDED
** IF CONCRETE SLAB IS LESS THAN 25MPa
6mil POLY MUST BE PROVIDED UNDER SLAB

DAMPPROOFING 9.13.2.

EXTERIOR WALL

- HOLES OR RECESS SHALL BE SEALED WITH CEMENT MORTAR OR DAMPPROOFING MATERIAL

INTERIOR WALL

- WHERE A BASEMENT IS BEING FINISHED THE INTERIOR SURFACE OF THE FOUNDATION WALL BELOW GRADE SHALL BE DAMPPROOFED

FLOORS ON GROUND

- WHERE 4" (100mm) OF GRANULAR FILL IS UNDER THE BASEMENT FLOOR NO DAMPPROOFING IS REQUIRED